


☉ SIDE SECTION

Plugged tee

PVC

1/16" x 3/4" stainless steel strap. Fasten with 1/2" x 1 1/2" galvanized bolts & lead anchors

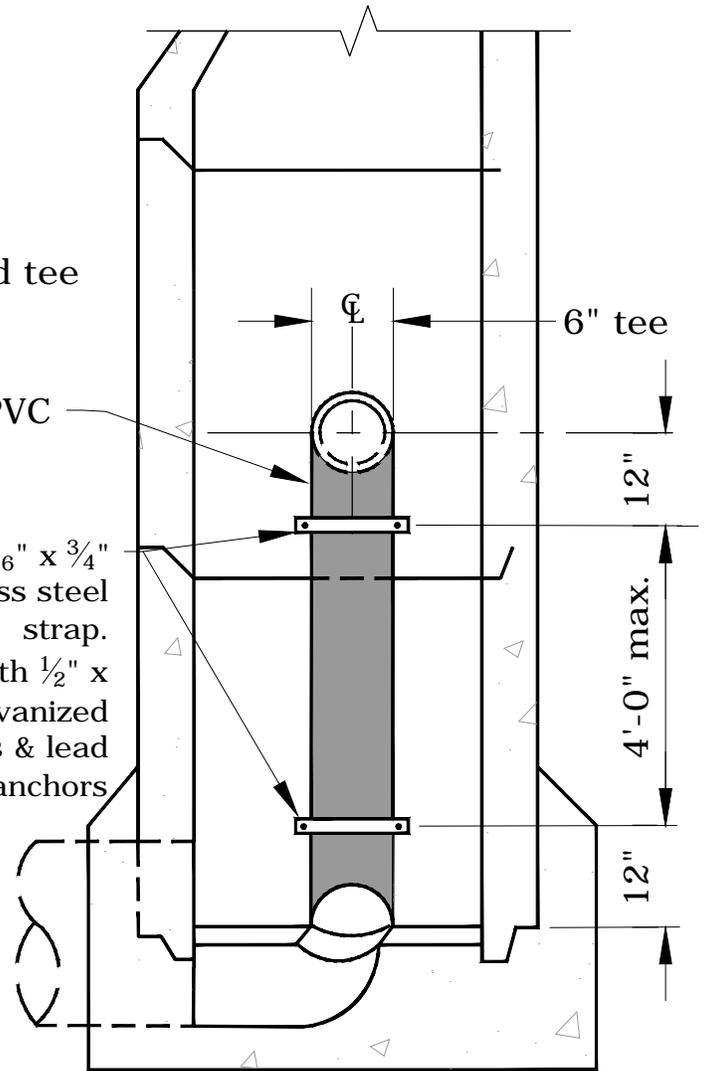

☉ FRONT SECTION

Notes:

- 1) For service lateral connection only when manhole is over 8'-0" deep or as approved by the City Engineer.
- 2) Inside drop pipe and fittings size must match the service lateral pipe size.



City of Lake Oswego
Engineering Division

Guy Graham, P.E. Public Works Director
City Engineer

INSIDE DROP & CONNECTION
TO EXISTING MANHOLE

DRAWING NUMBER: SD1-09

Drawn: DB	Redrawn:
Design: MS/GD	Redesigned:
Check: MS/GD	Update: KBK
Scale: N.T.S.	Update Check: DK
Date: 6/13/2000	Date/Update: 3/23/12